

HOME

FLOOR PLANS

RTU'S

LAB CONTROLS

LAB EXHAUST

GENERAL EXHAUST

HUMIDIFIERS

MISCELLANEOUS



CONCORDIA UNIVERSITY

N E B R A S K A





Mix Air Dmpr
Unit
EA Minimum
Unit

D-1
NO

EA

EF-4

ENABLE: # # # # # Digital Value

STATUS: # # # # # Digital Value

LOCATION: ROOF

BACKDRAFT DAMPER PROVIDED WITH FAN
INTERLOCK WIRTU-002

Mix Air Dmpr
Unit
EA Minimum
Unit

D-1
NO

EA

EF-5

ENABLE: # # # # # Digital Value

STATUS: # # # # # Digital Value

LOCATION: ROOF

BACKDRAFT DAMPER PROVIDED WITH FAN
INTERLOCK WIRTU-002

Mix Air Dmpr
Unit
EA Minimum
Unit

D-1
NO

EA

EF-6

ENABLE: # # # # # Digital Value

STATUS: # # # # # Digital Value

TTE-1
Unit

LOCATION: ROOF

BACKDRAFT DAMPER PROVIDED WITH FAN
INTERLOCK WIRTU-002

Mix Air Dmpr
Unit
EA Minimum
Unit

D-1
NO

EA

EF-8

ENABLE: # # # # # Digital Value


STATUS: # # # # # Digital Value

LOCATION: ROOF


BACKDRAFT DAMPER PROVIDED WITH FAN
INTERLOCK WIRTU-003 BUILDING A



System Enable: # Unit System Mode: # Unit

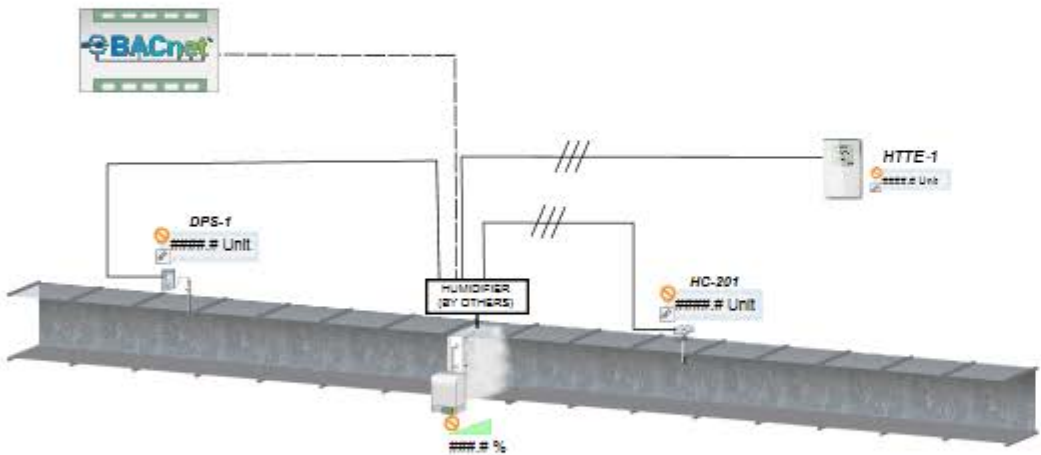

ROOM 13 HERB ANIMAL HUMIDIFIER
LOCATION: BUILDING B
SERVES: ROOM 13 HERB ANIMAL

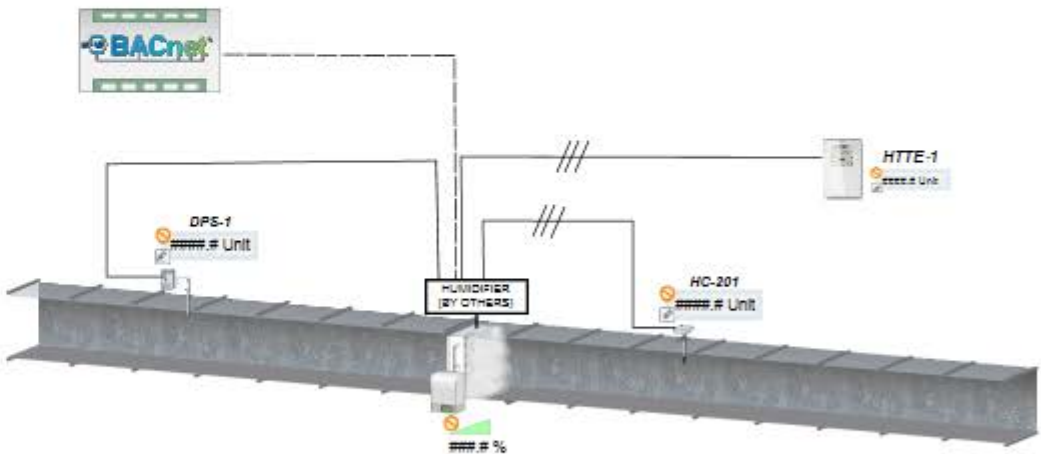

IT ROOM 38 HUMIDIFIER
LOCATION: BUILDING A
SERVES: ROOM 38 FIBER ROOM

- HOME
- FLOOR PLANS
- RTU'S
- LAB CONTROLS
- LAB EXHAUST
- GENERAL EXHAUST
- HUMIDIFIERS
- MISCELLANEOUS



212 LAB ROOM CONTROLS

227 LAB ROOM CONTROLS

213 LAB ROOM CONTROLS


229 LAB ROOM CONTROLS

225 LAB ROOM CONTROLS


230 LAB ROOM CONTROLS

226 LAB ROOM CONTROLS


232 LAB ROOM CONTROLS

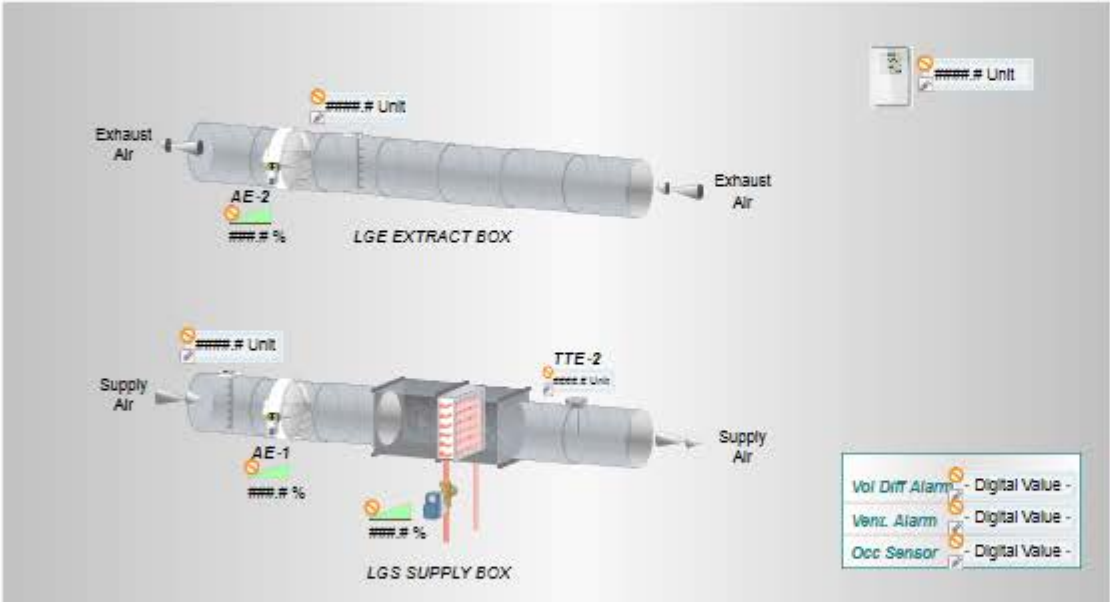


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: FUME HOODS RM 212 APP# 10751_212

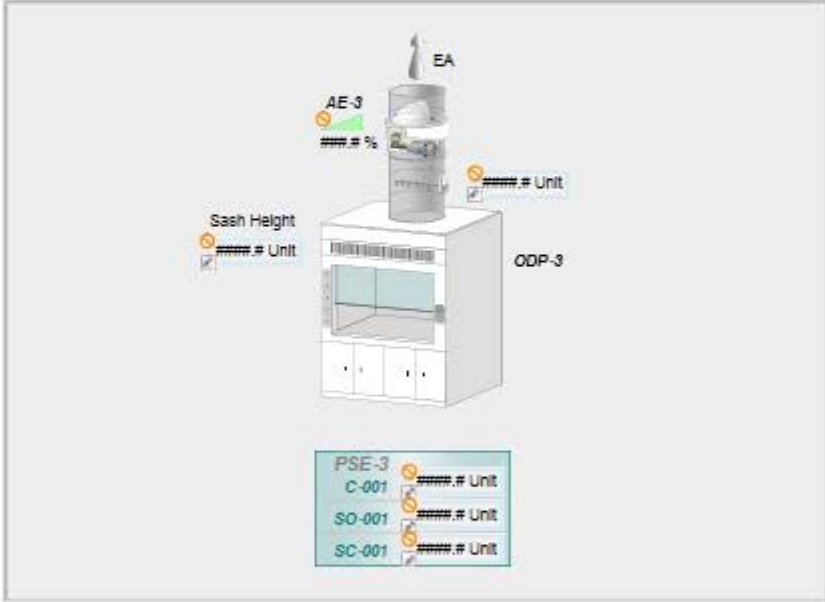


VAV-FHC MODULATING DAMPER
SERVES: FUME HOODS RM 212 APP# 10741_FH

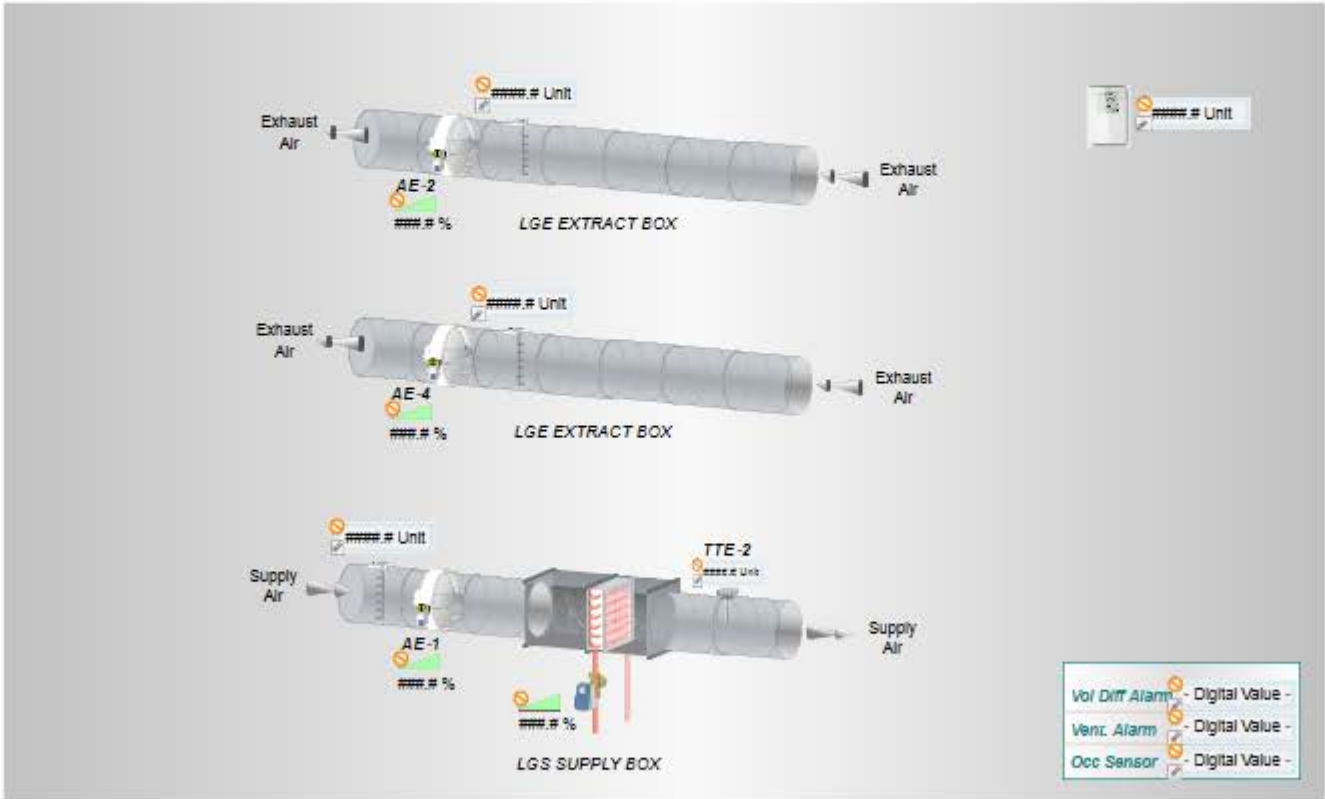


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-008 APP#10751-213

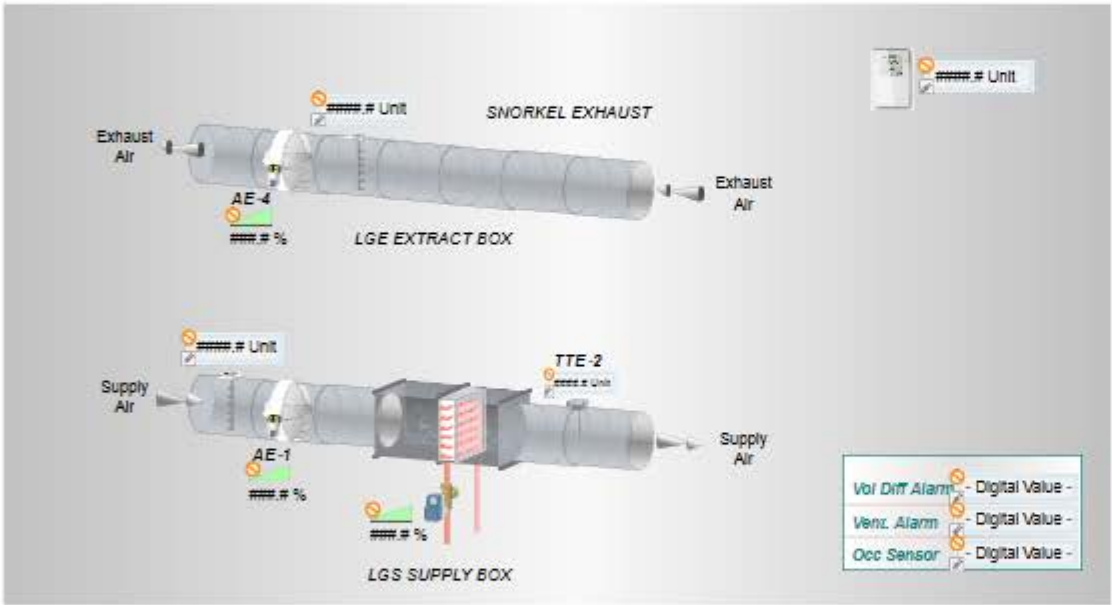


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-000 APP# 10751_225

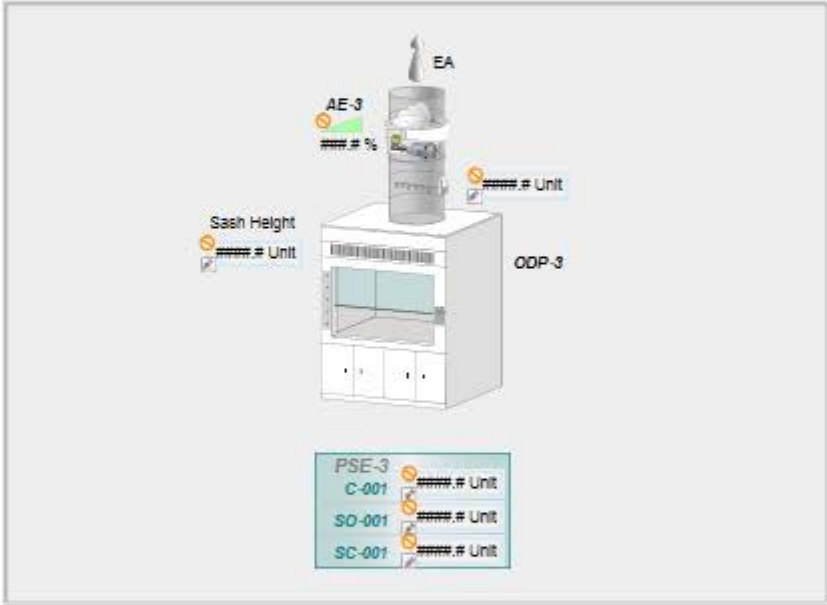


VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 225 APP# 10741_FH

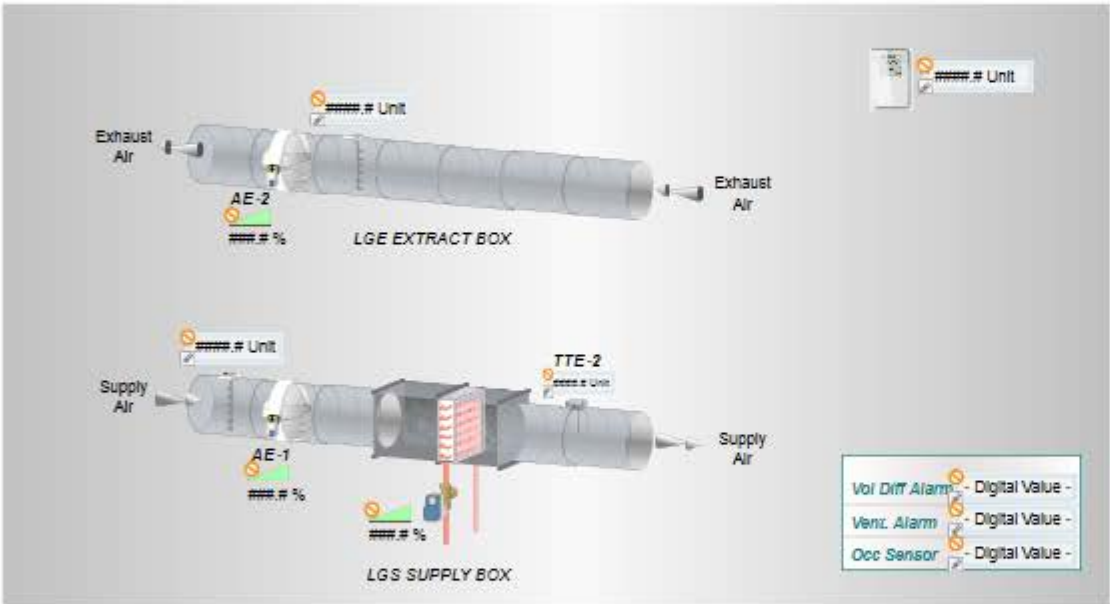


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-000 APP# 10751_220

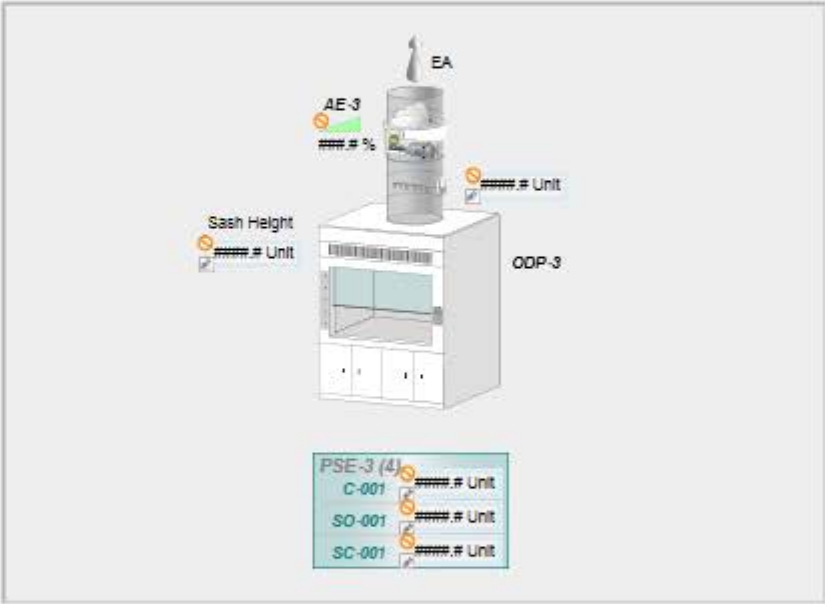


VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 220-1, 220-2, 220-3, 220-4 APP# 10741_FH

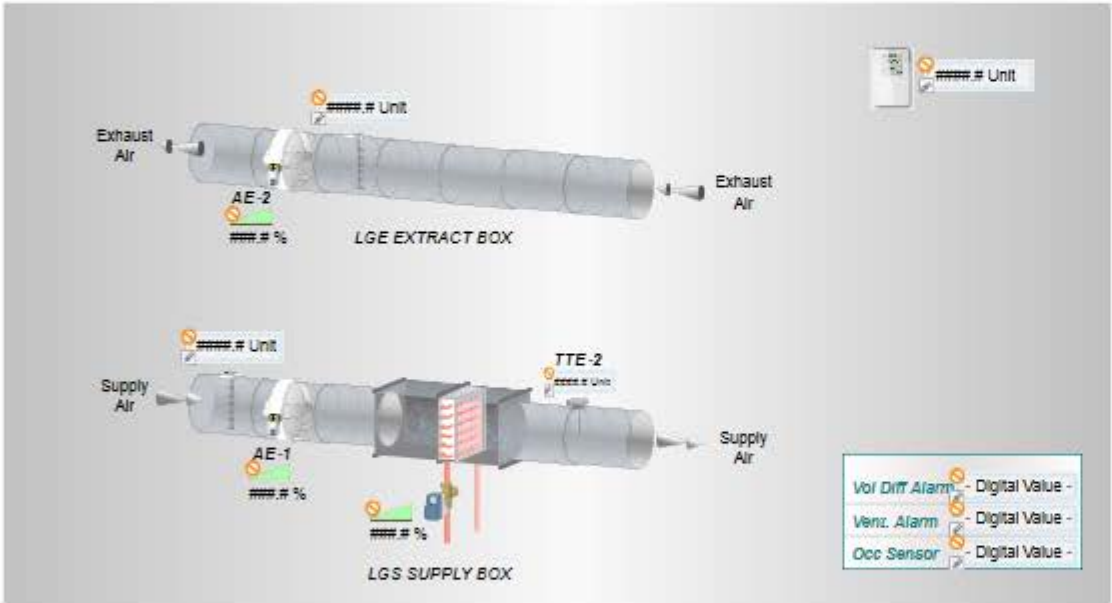


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-004 APP# 10751_227

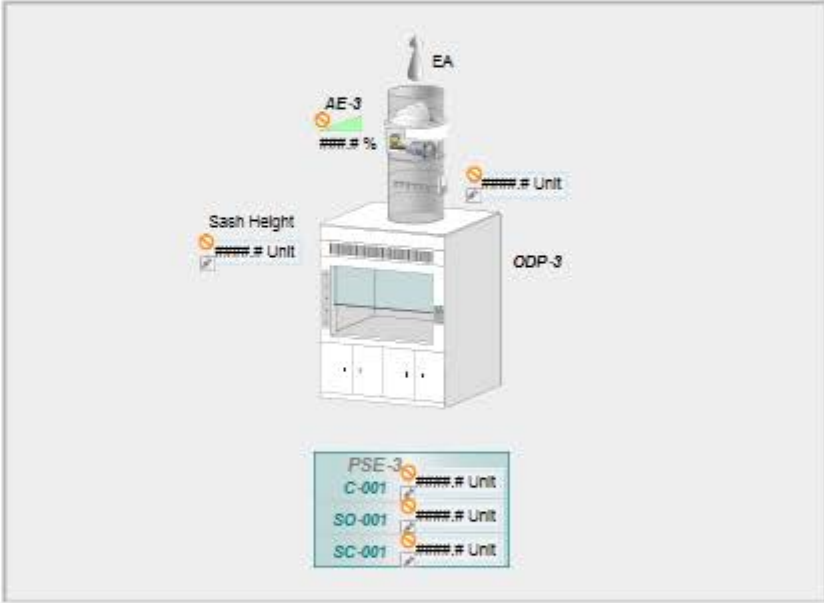


VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 227 APP# 10741_FH

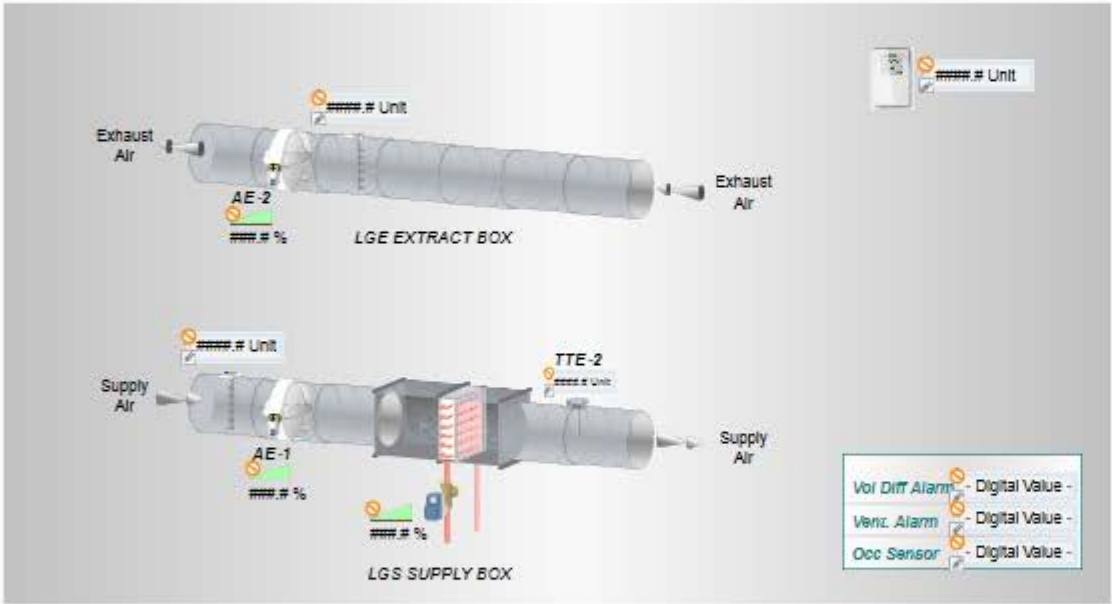


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-001 APP# 10751_229

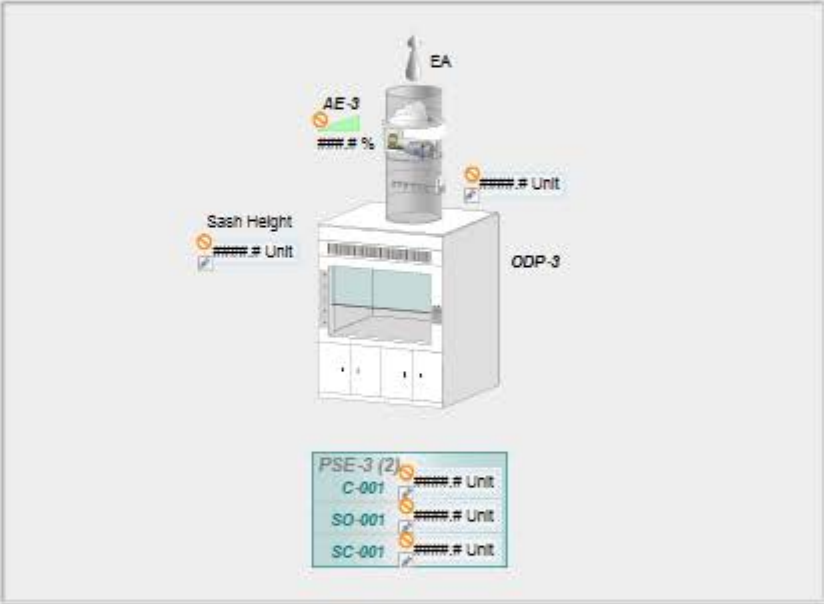


VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 229-1, 229-2 APP# 10741_FH

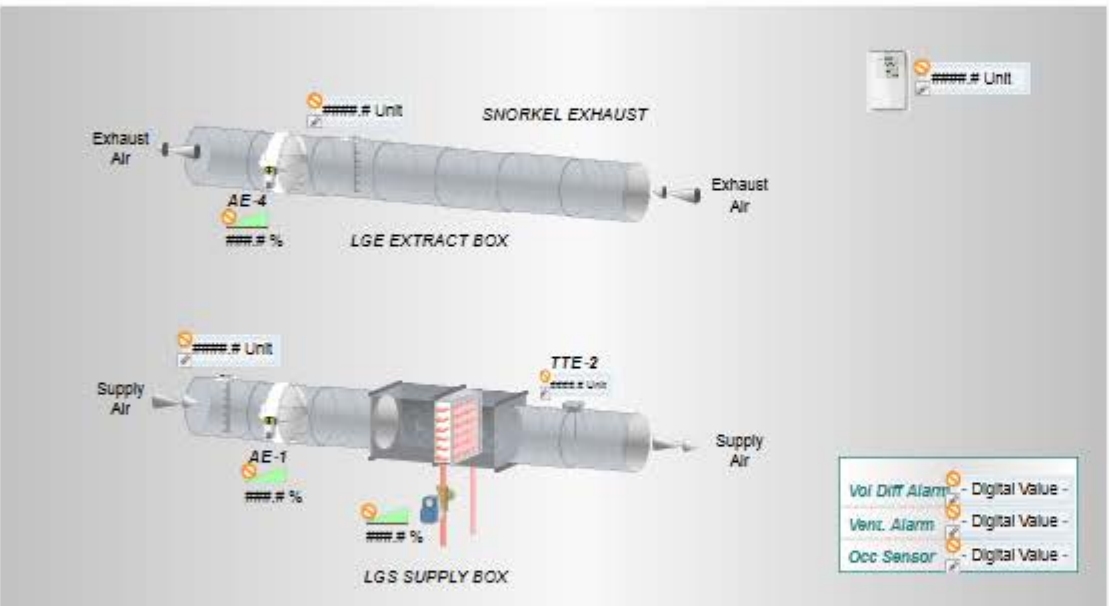


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-002 APP# 10751_230

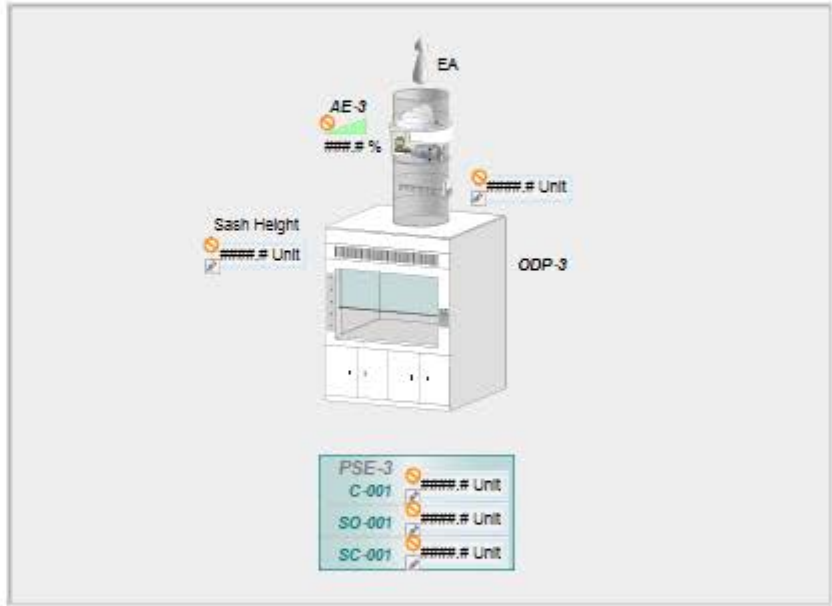


VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 230 APP# 10741_FH

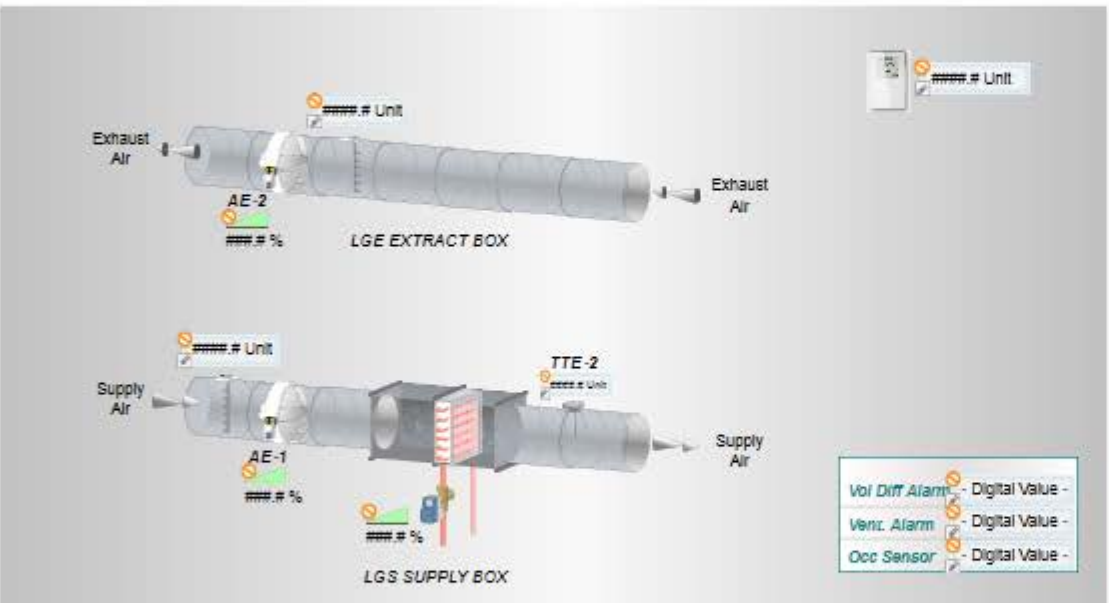


VAV-LRC - FAST ACT VAV W/ELEC RHT
SERVES: LAB VAV SAV001B-003 APP# 10751_232

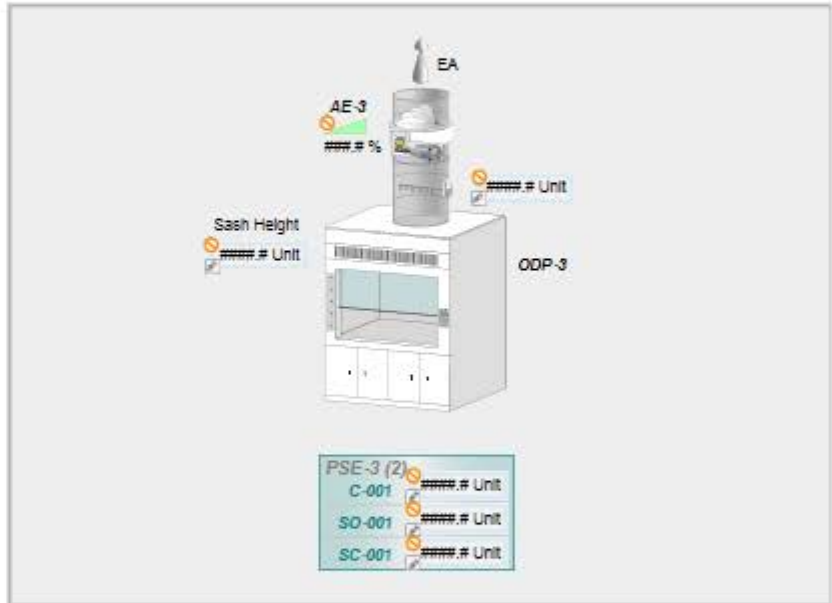

VAV-FHC MODULATING DAMER
SERVES: FUME HOODS RM 232-1, 232-2 APP# 10741_FH

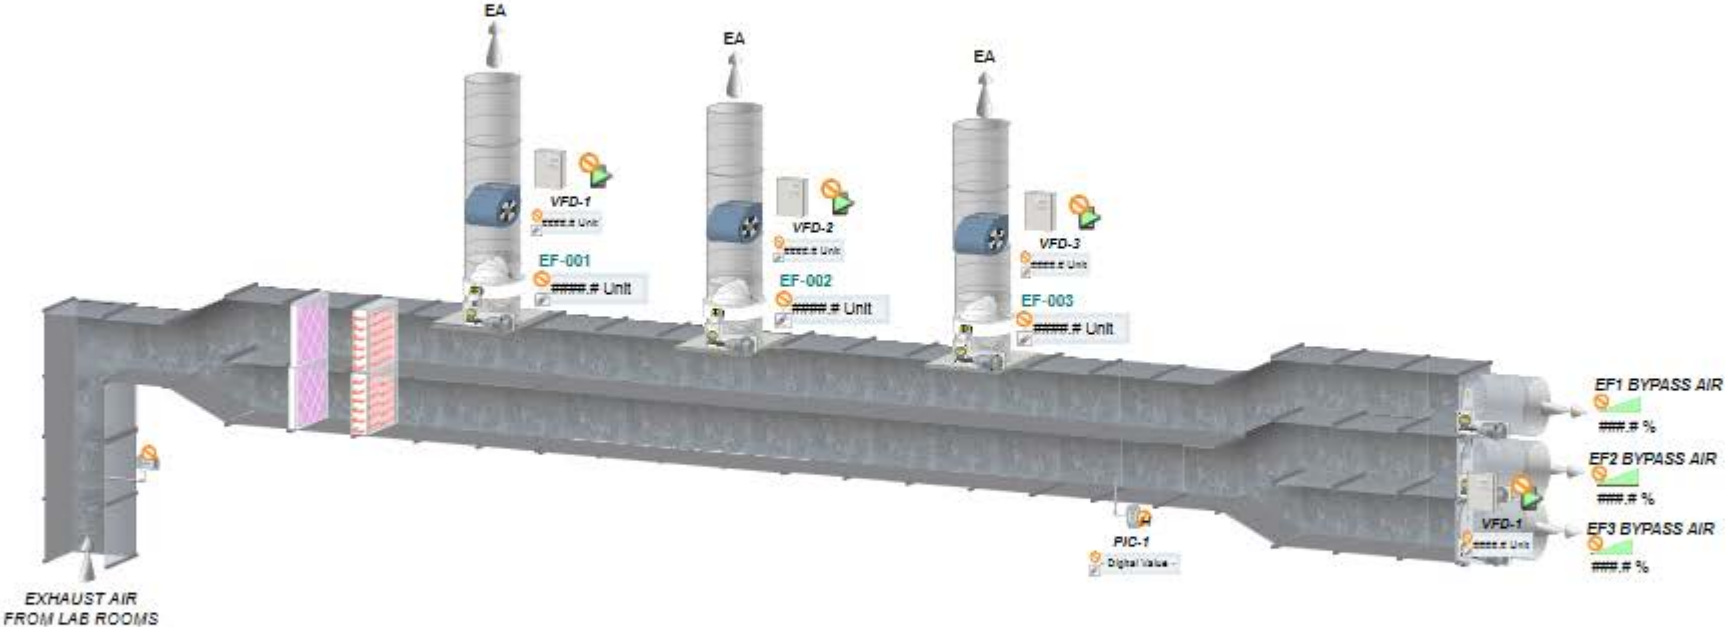

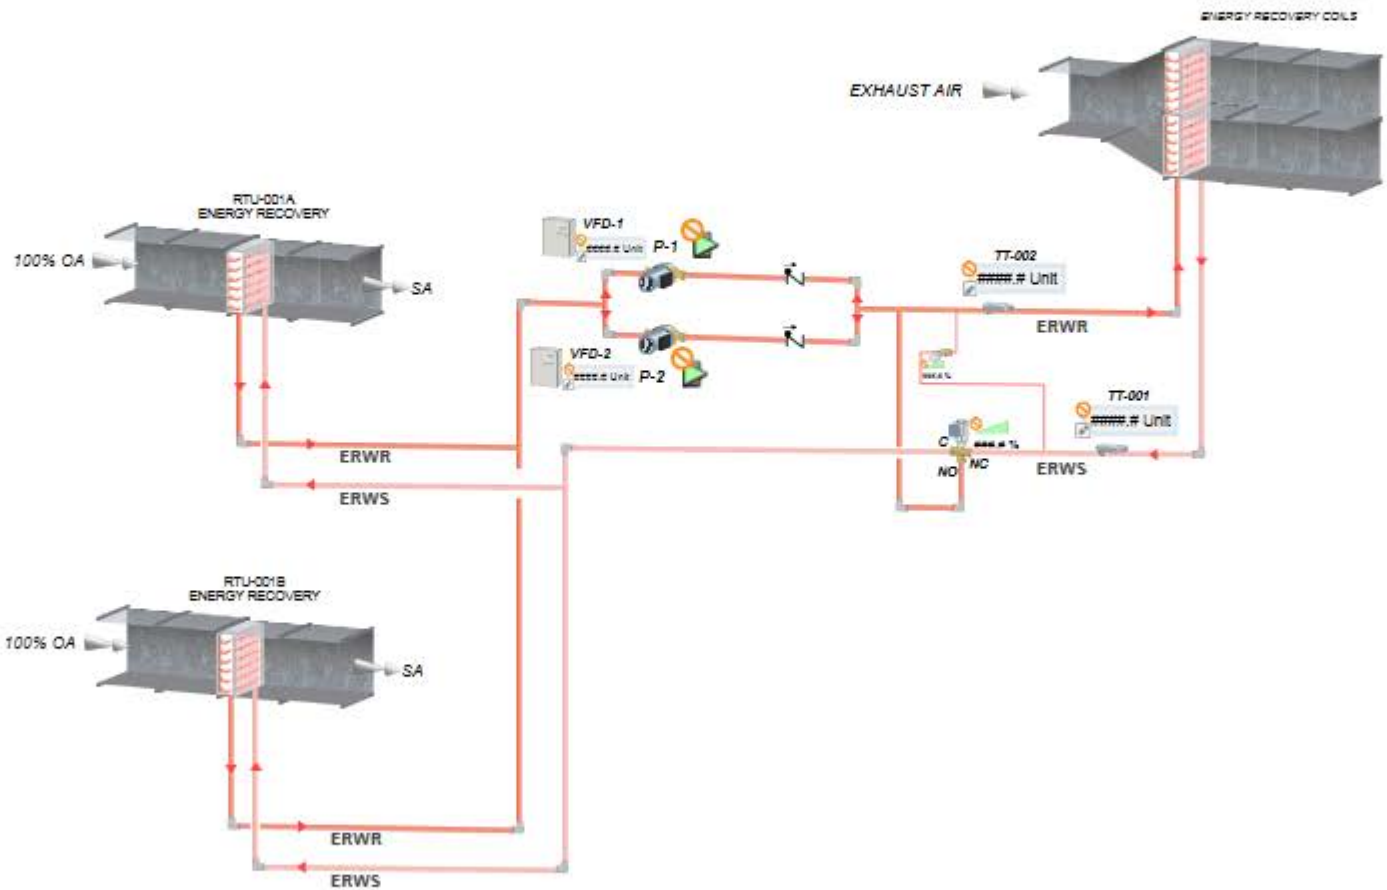


[HOME](#)[FLOOR PLANS](#)[RTU'S](#)[LAB CONTROLS](#)[LAB EXHAUST](#)[GENERAL EXHAUST](#)[HUMIDIFIERS](#)[MISCELLANEOUS](#)[RTU-001A CONTROL](#)[RTU-001B CONTROL](#)[RTU-002 CONTROL](#)[RTU-003 CONTROL](#)



System Enable: # Unit System Mode: # Unit

Cool Mode Request	- Digital Value -
Occupancy Request	- Digital Value -
Occupancy Status	- Digital Value -
Communication Failure	- Digital Value -
Fire Alarm Mode	- Digital Value -
High Duct Static	- Digital Value -

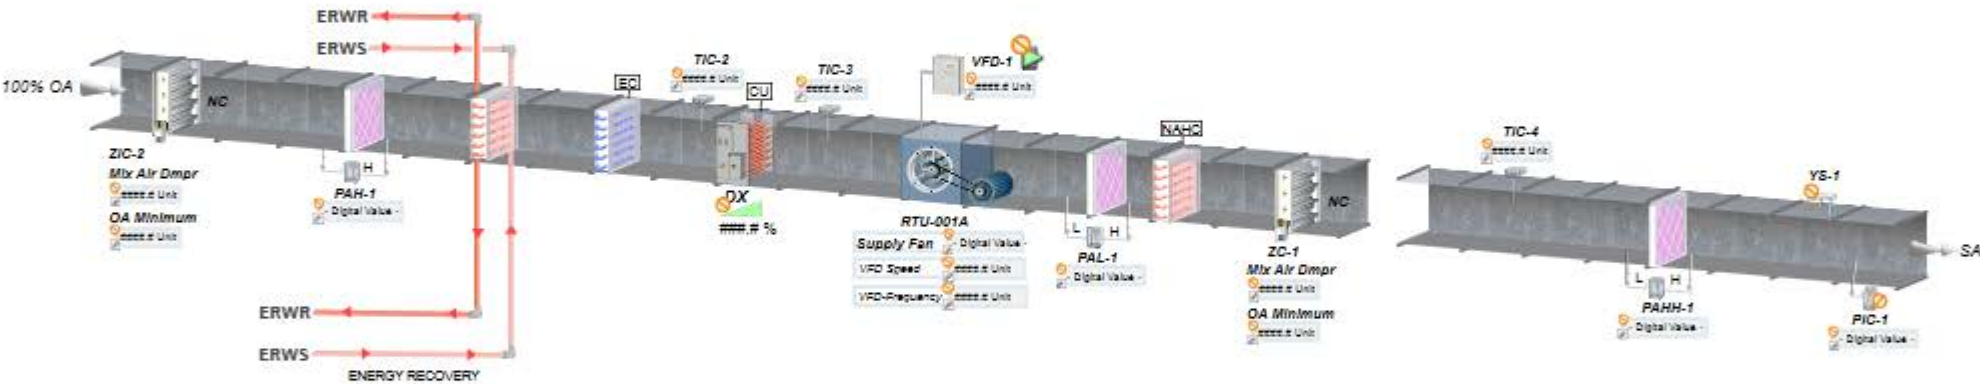




System Enable: # Unit

System Mode: # Unit

Cool Mode Request	- Digital Value -
Occupancy Request	- Digital Value -
Occupancy Status	- Digital Value -
Communication Failure	- Digital Value -
Fire Alarm Mode	- Digital Value -
High Duct Static	- Digital Value -

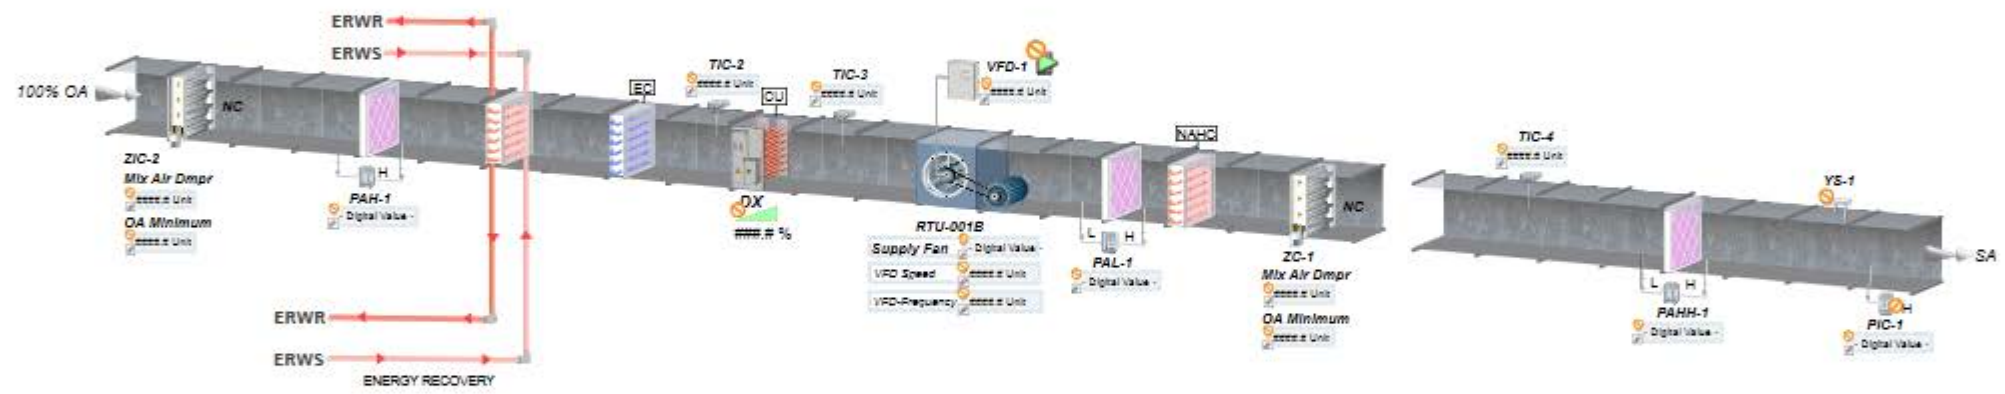


LOCATION: ROOF - STEM B



System Enable: # Unit System Mode: # Unit

Cool Mode Request	- Digital Value -
Occupancy Request	- Digital Value -
Occupancy Status	- Digital Value -
Communication Failure	- Digital Value -
Fire Alarm Mode	- Digital Value -
High Duct Static	- Digital Value -

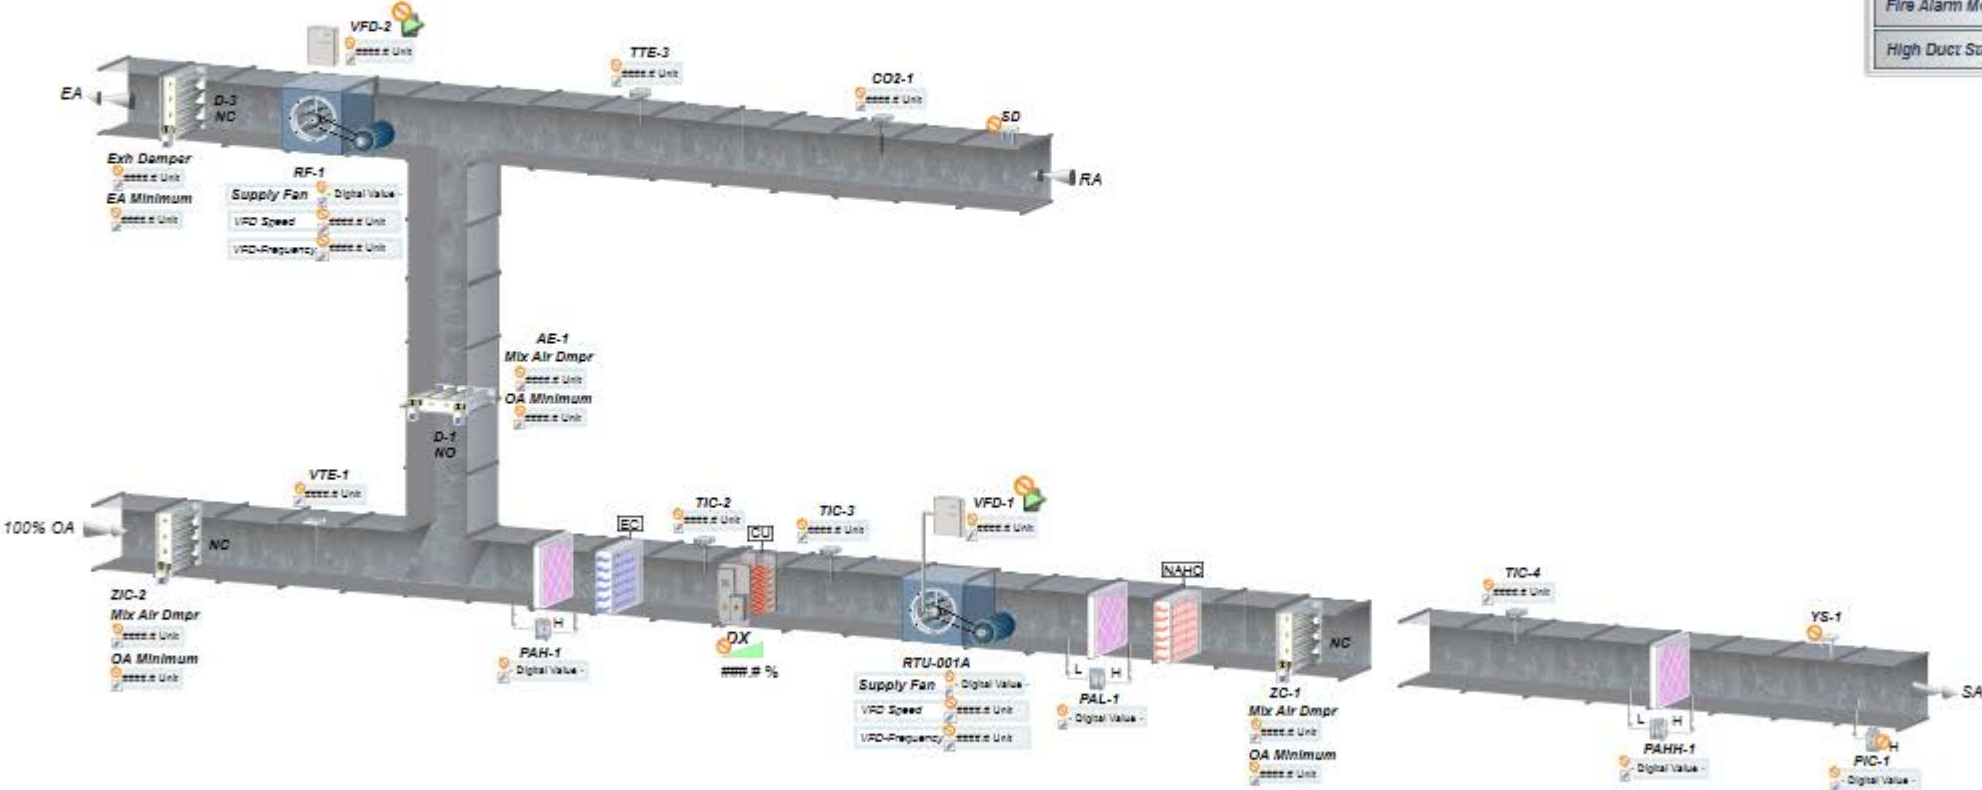


LOCATION: ROOF - STEM B



System Enable: # Unit System Mode: # Unit

Cool Mode Request	- Digital Value -
Occupancy Request	- Digital Value -
Occupancy Status	- Digital Value -
Communication Failure	- Digital Value -
Fire Alarm Mode	- Digital Value -
High Duct Static	- Digital Value -

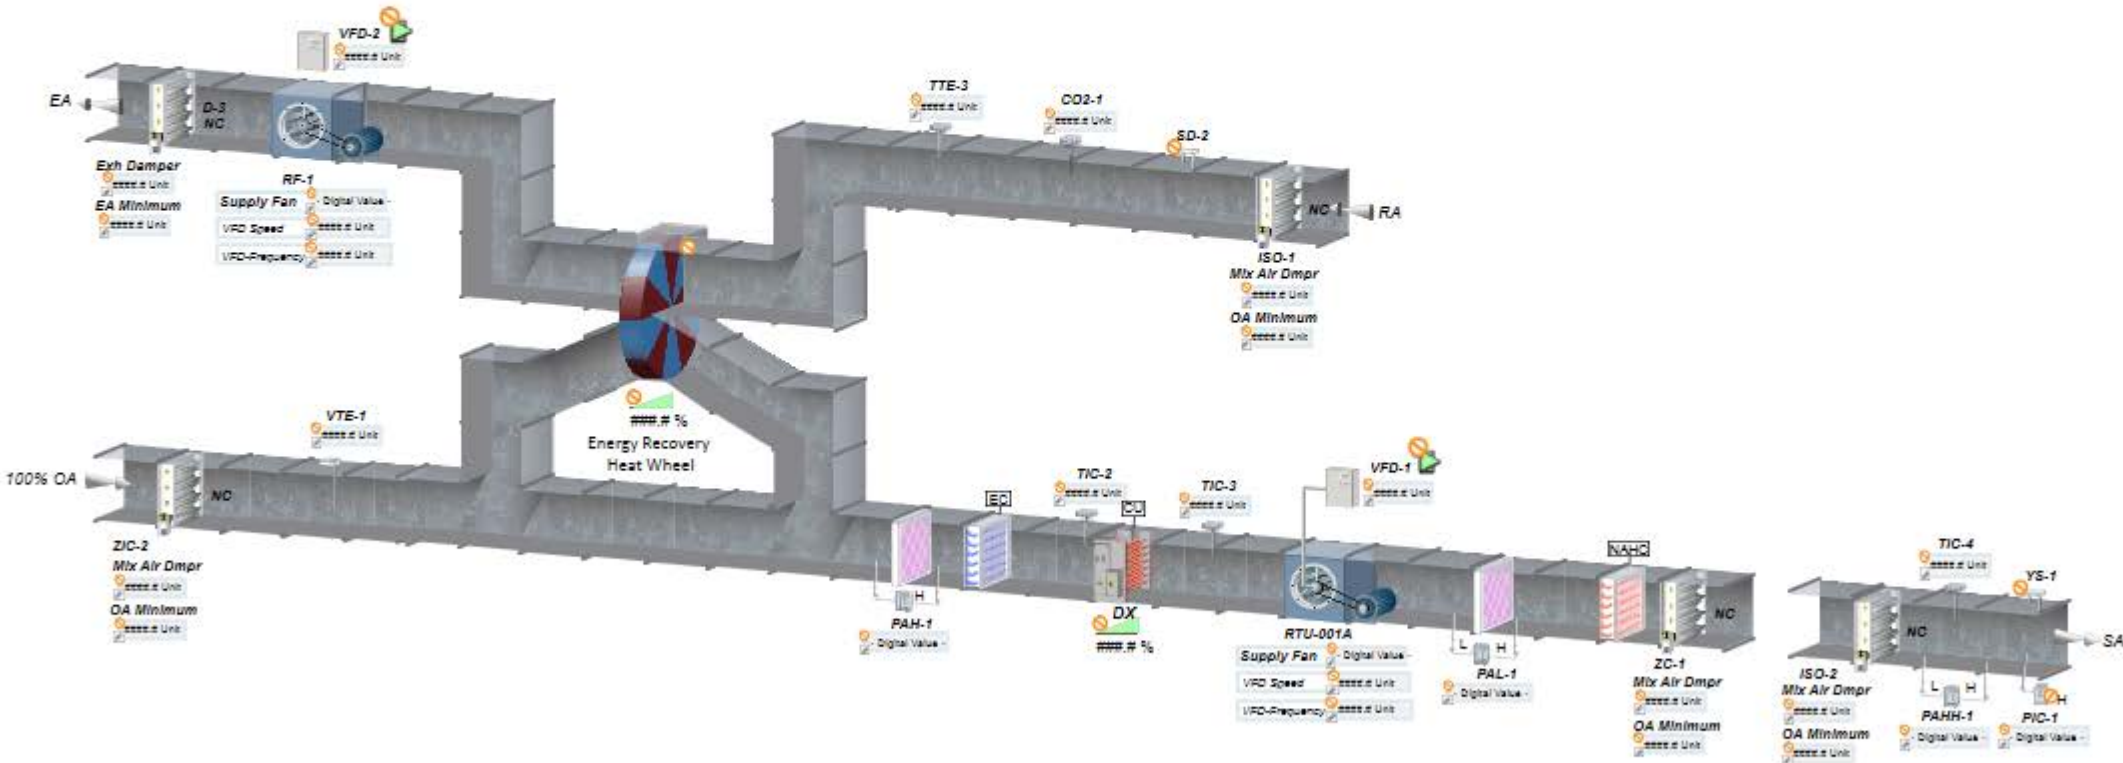

LOCATION: ROOF - STEM A

HOME

FLOOR PLANS

RTU'S

LAB CONTROLS

LAB EXHAUST


GENERAL EXHAUST

HUMIDIFIERS

MISCELLANEOUS



LOWER LEVEL

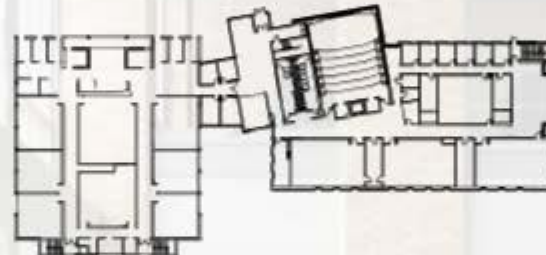

MAIN LEVEL



UPPER LEVEL



HOME

FLOOR PLANS

RTU'S


LAB CONTROLS

LAB EXHAUST

GENERAL EXHAUST

HUMIDIFIERS

MISCELLANEOUS

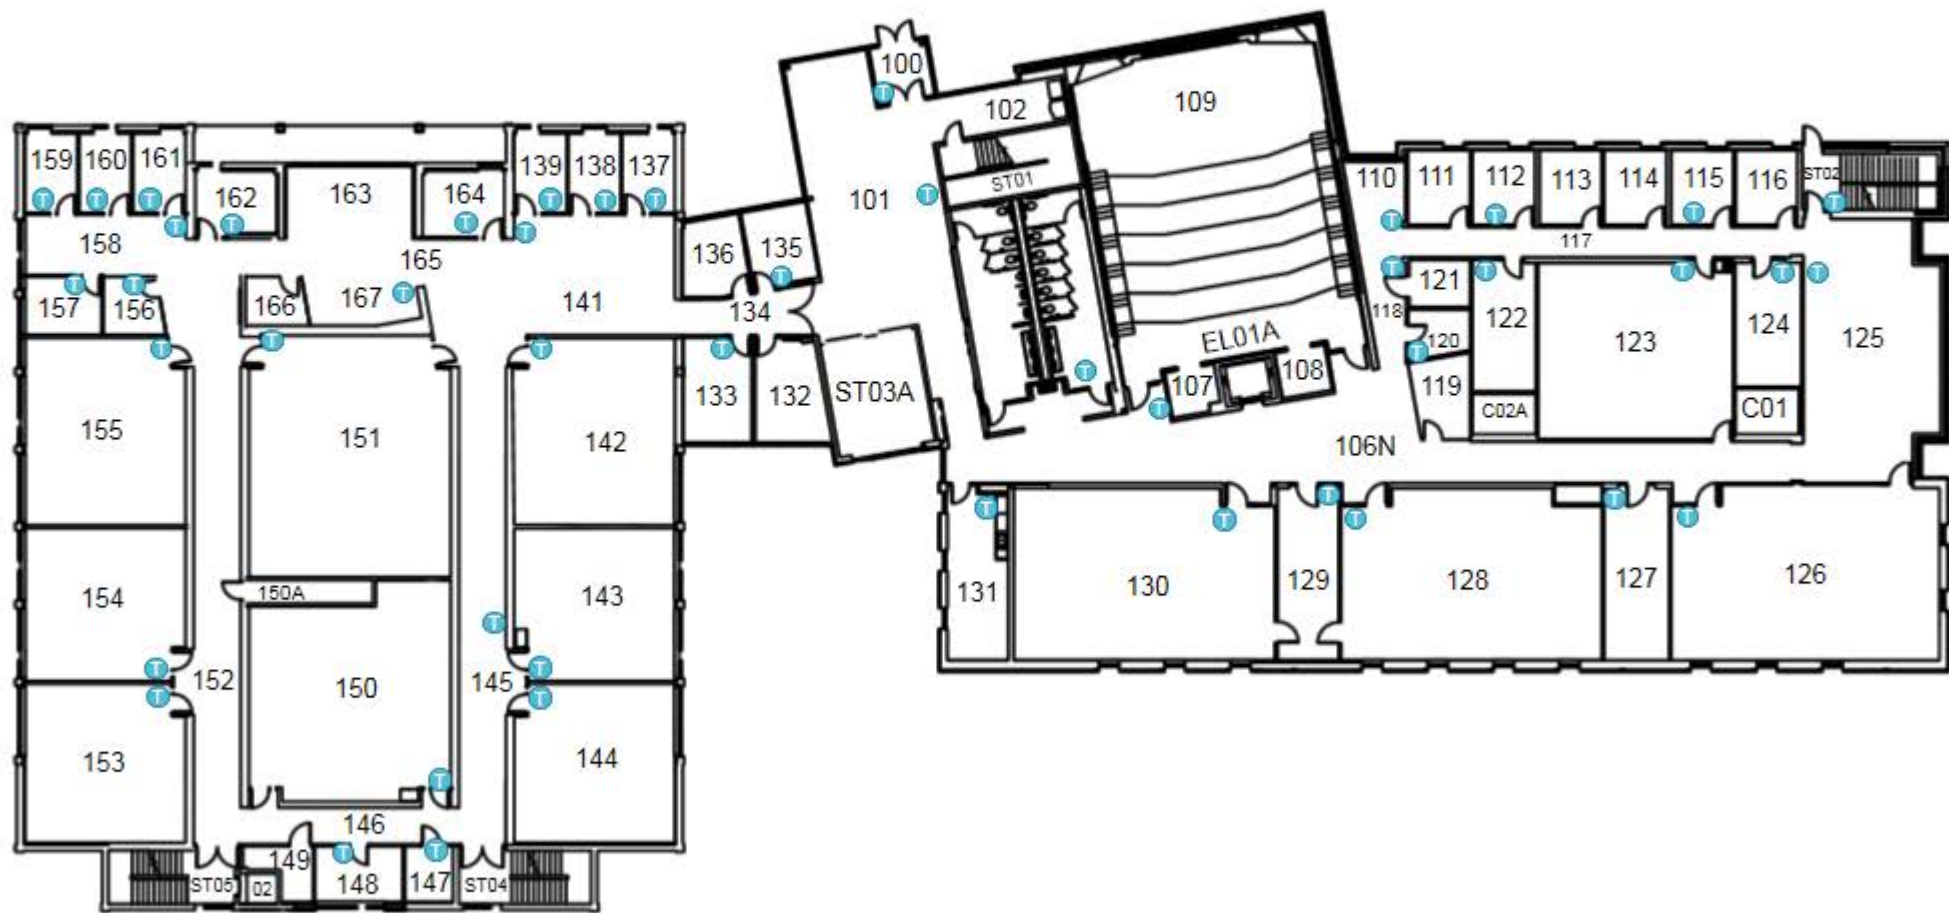



HOME

FLOOR PLANS

RTU'S

LAB CONTROLS

LAB EXHAUST

GENERAL EXHAUST

HUMIDIFIERS

MISCELLANEOUS





ENERGY RECOVERY SYSTEM

ROOM PRESS CONTROLLER

VAV W/SCR HEAT

VRV SYSTEMS

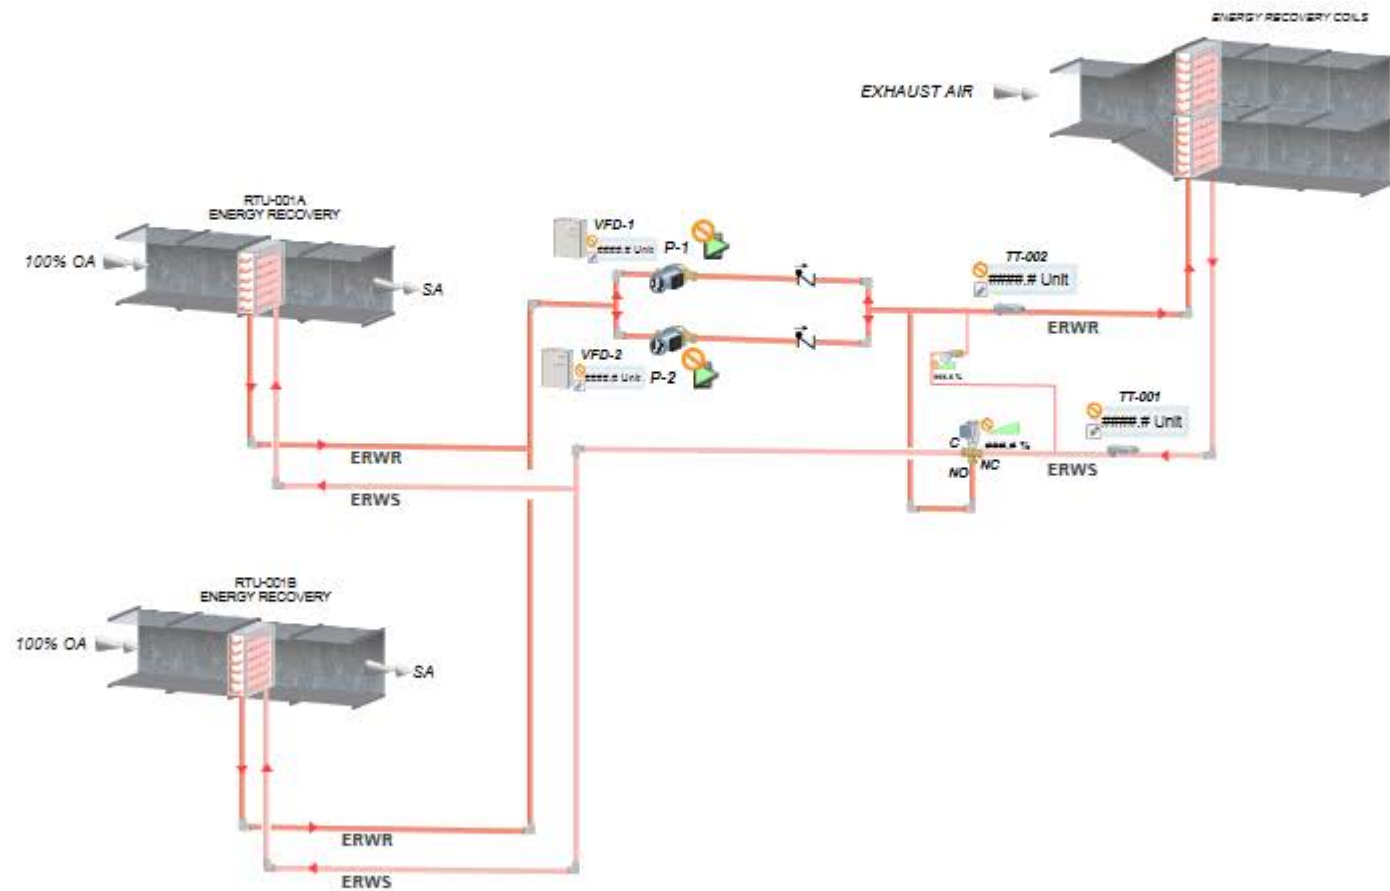

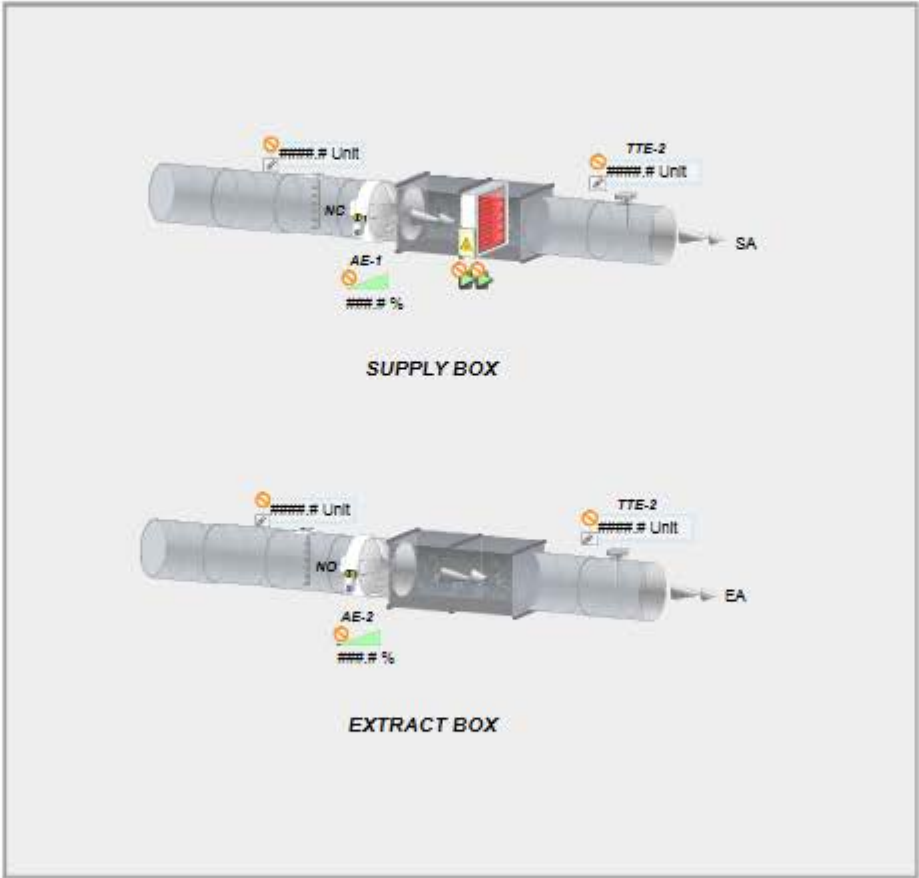

HOME

FLOOR PLANS

RTU'S

LAB CONTROLS

LAB EXHAUST

GENERAL EXHAUST

HUMIDIFIERS

MISCELLANEOUS

